

2-2011

Outdoor PV degradation comparison

Dirk C. Jordan
National Renewable Energy Laboratory

R. M. Smith
National Renewable Energy Laboratory

C. R. Osterwald
National Renewable Energy Laboratory

E. Gelak
National Renewable Energy Laboratory

Sarah R. Kurtz
National Renewable Energy Laboratory

Follow this and additional works at: https://digitalscholarship.unlv.edu/renew_pubs



Part of the [Oil, Gas, and Energy Commons](#), and the [Sustainability Commons](#)

Repository Citation

Jordan, D. C., Smith, R. M., Osterwald, C. R., Gelak, E., Kurtz, S. R. (2011). Outdoor PV degradation comparison. 1-7.

Available at: https://digitalscholarship.unlv.edu/renew_pubs/46

This Conference Proceeding is protected by copyright and/or related rights. It has been brought to you by Digital Scholarship@UNLV with permission from the rights-holder(s). You are free to use this Conference Proceeding in any way that is permitted by the copyright and related rights legislation that applies to your use. For other uses you need to obtain permission from the rights-holder(s) directly, unless additional rights are indicated by a Creative Commons license in the record and/or on the work itself.

This Conference Proceeding has been accepted for inclusion in Publications (E) by an authorized administrator of Digital Scholarship@UNLV. For more information, please contact digitalscholarship@unlv.edu.



Outdoor PV Degradation Comparison

D.C. Jordan, R.M. Smith, C.R. Osterwald,
E. Gelak, and S.R. Kurtz

*Presented at the 35th IEEE Photovoltaic Specialists Conference
(PVSC '10)
Honolulu, Hawaii
June 20-25, 2010*

NREL is a national laboratory of the U.S. Department of Energy, Office of Energy Efficiency & Renewable Energy, operated by the Alliance for Sustainable Energy, LLC.

Conference Paper
NREL/CP-5200-47704
February 2011

Contract No. DE-AC36-08GO28308

NOTICE

The submitted manuscript has been offered by an employee of the Alliance for Sustainable Energy, LLC (Alliance), a contractor of the US Government under Contract No. DE-AC36-08GO28308. Accordingly, the US Government and Alliance retain a nonexclusive royalty-free license to publish or reproduce the published form of this contribution, or allow others to do so, for US Government purposes.

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available electronically at <http://www.osti.gov/bridge>

Available for a processing fee to U.S. Department of Energy and its contractors, in paper, from:

U.S. Department of Energy
Office of Scientific and Technical Information

P.O. Box 62
Oak Ridge, TN 37831-0062
phone: 865.576.8401
fax: 865.576.5728
email: <mailto:reports@adonis.osti.gov>

Available for sale to the public, in paper, from:

U.S. Department of Commerce
National Technical Information Service
5285 Port Royal Road
Springfield, VA 22161
phone: 800.553.6847
fax: 703.605.6900
email: orders@ntis.fedworld.gov
online ordering: <http://www.ntis.gov/help/ordermethods.aspx>

Cover Photos: (left to right) PIX 16416, PIX 17423, PIX 16560, PIX 17613, PIX 17436, PIX 17721



Printed on paper containing at least 50% wastepaper, including 10% post consumer waste.

OUTDOOR PV DEGRADATION COMPARISON

D.C. Jordan, R.M. Smith, C.R. Osterwald, E. Gelak, S.R. Kurtz
National Renewable Energy Laboratory, Golden, CO 80401, USA

ABSTRACT

As photovoltaic (PV) penetration of the power grid increases, it becomes vital to know how decreased power output may affect cost over time. In order to predict power delivery, the decline or degradation rates must be determined accurately. At the Performance and Energy Rating Testbed (PERT) at the Outdoor Test Facility (OTF) at the National Renewable Energy Laboratory (NREL) more than 40 modules from more than 10 different manufacturers were compared for their long-term outdoor stability. Because it can accommodate a large variety of modules in a limited footprint the PERT system is ideally suited to compare modules side-by-side under the same conditions.

INTRODUCTION

The ability to accurately predict power delivery over the course of time is key to growth of the maturing photovoltaic (PV) industry [1]. For realistic PV lifespan estimation, the knowledge of power decline over time is essential and important to all stakeholders—utility companies, investors, and researchers alike. Outdoor field testing has played a vital part of determining PV field performance and lifetime for at least two reasons: (1) It is a non-trivial task to correlate indoor testing to outdoor results [2] and (2) it is the typical operating environment of PV modules [3]. A wealth of excellent information has been reported in the literature measuring degradation rates with respect to technologies, age, manufacturers, and geographic locations. Instead of citing the most significant contributions here, which would certainly be incomplete, an attempted summary of reported degradation rates is shown in Fig. 1. The histogram has to be understood as a temporary frame in time since new data are continuously being added. The above mentioned

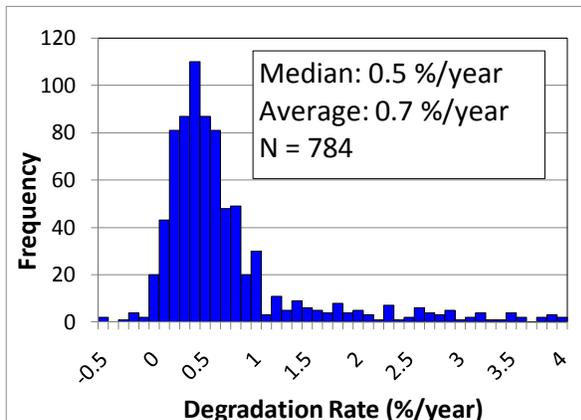


Figure 1 Histogram of published degradation rates.

factors such as technology and location all have different influence on the determined degradation rate, however, it is important to note that most frequent degradation rate is below 1 %/year.

In this paper we will focus on determining degradation rates from continuous data obtained from the PERT system at NREL which has been described in detail previously [4,5]. More than 40 different modules from more than 10 manufacturers were compared for their long-term outdoor stability. Module installations varied greatly with the earliest installations occurring in 1993. There was an equally large variation in the monitoring times from merely a few months to more than 16 years of continuous data. Due to increased uncertainty, no degradation rates were calculated for monitoring times below two years. Different technologies included amorphous-, mono- and poly-crystalline silicon, cadmium telluride (CdTe) and copper indium gallium selenide (CIGS).



Figure 2 Performance Energy Rating Testbed (PERT) at NREL. Photo credit: Warren Gretz, NREL PIX 03877.

DEGRADATION RATE MEASUREMENTS

The modules, mounted at latitude tilt of 40° facing south, are held at maximum power with IV curves taken every 15 minutes. The Photovoltaics for Utility Scale Applications (PVUSA) methodology was used to determine long-term degradation rates. In this methodology, as a first step, the maximum power in monthly intervals is normalized to PVUSA Test Conditions (PTC) [6] by using Eqn. 1 [7,8].

$$P = E \cdot (a_1 + a_2 \cdot E + a_3 \cdot T_{ambient} + a_4 \cdot ws) \quad (1)$$

In Equation 1, P is the maximum DC power, E the irradiance, $T_{ambient}$ the ambient temperature, w the wind speed, and a_1 to a_4 are regression coefficients. Data at irradiance levels below 800 W/m^2 were eliminated from the analysis because extrapolation from low-irradiance levels to PTC increases the model uncertainty. In the second step, the monthly normalized data are graphed as a time series and degradation rates determined from a linear least square fit, as shown by the example in Fig. 3. The statistical uncertainty for the degradation rates, the Type A uncertainty according to the ISO guide to the Expression of Uncertainty [9], is calculated from the standard errors of the slope and intercept of the linear fit using error propagation.

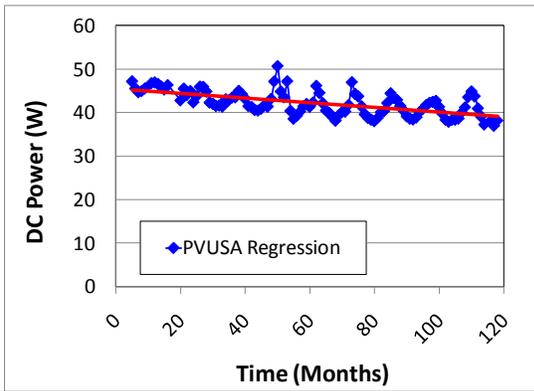


Figure 3 Example of an amorphous Si module with a linear fit using standard least square.

PYRANOMETER CALIBRATION

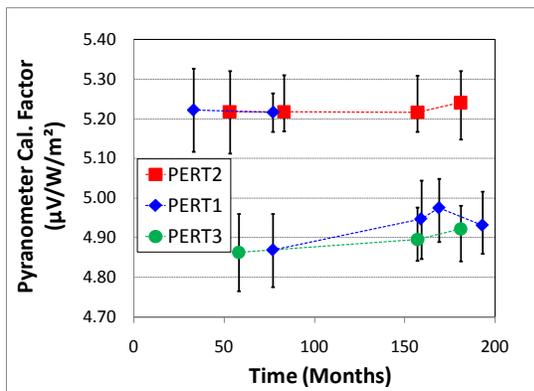


Figure 4 Pyranometer calibration factors determined at 45° at the Solar Radiation Research Laboratory at NREL.

The PERT system consists of three subsystems, each equipped with its own plane-of-array Kipp & Zonen CM11 pyranometer. The pyranometers are regularly calibrated at the Solar Radiation Research Laboratory (SRRL) at NREL using the Broadband Outdoor Radiometer

Calibration (BORCAL) procedure [10]. Figure 4 shows the calibration factors in $\mu\text{V/W/m}^2$ for all pyranometers used for the PERT system. A systematic change in the calibration procedure in 2000, month 82, led to decreased measurement uncertainty and has been accounted for in Fig. 4 [11]. The large jump for PERT1 was caused by a change to a pyranometer with a different calibration factor. These calibration factors were subsequently used to normalize the irradiance measurements for each month of observation for each module. As a simplifying approximation, it was assumed that the respective pyranometers changed linearly between calibration dates.

ANALYSIS & DISCUSSION

For non-spectrally corrected measurements, particularly using pyranometers, it is well known that due to seasonal changes, several complete cycles (typically 3-5 years) need to be completed to obtain reasonably accurate degradation rates [12]. Figure 5 gives the explanation for this requirement. In this figure the degradation rate uncertainty is plotted against the monitoring length of time separated by technology. The uncertainty appears to decrease exponentially and seems independent of technology. For a desired statistical uncertainty the required observation time can then be directly determined from this curve. As shown in Fig. 1, the median historically reported degradation rate is 0.5 %/year and the average 0.7 %/year which results in circa 3-5 years from Fig. 5.

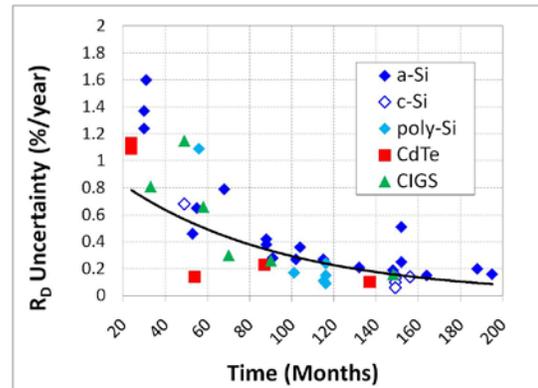


Figure 5 Degradation rate uncertainty versus observation time, separated by technology.

The next step is to investigate the determined degradation rates. Modules were divided by installation date as pre-2000 and post-2000. The choice of the year 2000 is somewhat arbitrary and was mostly driven by the decision to have a roughly equal number of modules for each category. Furthermore, the effect of different manufacturers was investigated although the sample size for that was small since only two different manufacturers had multiple technologies installed on the PERT system. It was then possible to statistically analyze the calculated

data by doing an Analysis of Variance (ANOVA). The ANOVA partitions the overall observed variation of the degradation rates into its components depending on the variables technology, manufacturer and date of installation (DOI) of the module. From the partition in Fig. 6 it can be seen that manufacturer contributed only a small part to the overall variation, although the small sample size must be born in mind. Date of installation of the module, however, dominates the overall variation, followed by technology. The category “within” is the error variance within each group.

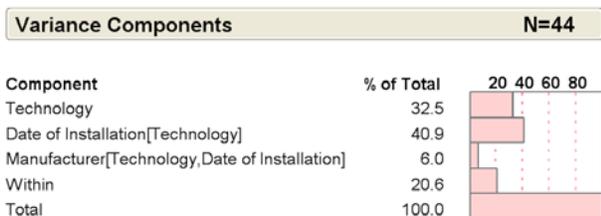


Figure 6 Variance components of determined degradation rates. N is the total number of modules.

Since the variable manufacturer contributed only minutely to the overall degradation rate variation, only technology and date of installation were considered for the following analysis. Figure 7 shows the degradation rates partitioned into DOI and technology only. Amorphous Si modules installed before and after 2000 had similar degradation rates. Unfortunately, no new crystalline Si modules were installed after 2000, therefore no direct comparison was possible. It appears that great improvements of the technologies CdTe, CIGS and poly-Si have been achieved although only one new CIGS module has been tested long enough to produce a believable degradation rate.

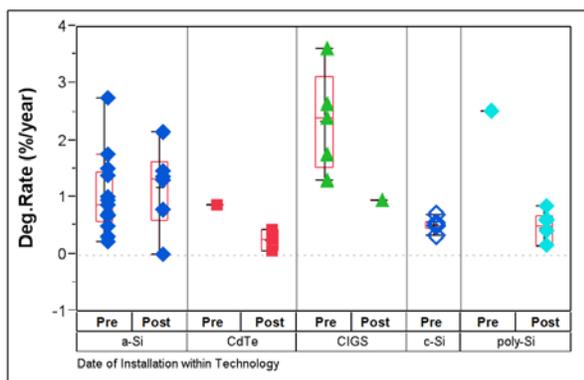


Figure 7 Degradation rates partitioned by technology and age.

CONCLUSION

Over 40 modules of different age, technology and manufacturer were directly compared for their degradation rates. The uncertainty in the degradation rate decreases exponentially with increasing monitoring time and appears to be independent of technology. The most important factor contributing to the degradation rate is the date of the installation of the module followed by the diverse technologies. It appears that CdTe, CIGS and poly-Si modules manufactured after the year 2000 exhibit improved stability relative to older designs.

ACKNOWLEDGMENT

We would like to thank Bill Marion, Joe Del Cueto and David Trudell for their contribution to the operation of the PERT system. This work was supported by the U.S. Department of Energy under Contract No. DE-AC36-08-GO28308 with the National Renewable Energy Laboratory.

REFERENCES

- [1] Kurtz S, Granata J, Quintana M. Photovoltaic Reliability R&D toward a Solar-Powered World. Proceedings of the SPIE, San Diego, 2009, 7412.
- [2] P. Hacke et al., “Test-to-Failure of Crystalline Silicon Modules”, Proc. 35th PVSC, 2010.
- [3] J.H. Wolgemuth, “Reliability Testing of PV Modules”, Proc. WCPEC, 1994, pp. 889-892.
- [4] J.A. del Cueto, “Closed-Form Solutions and Parameterization of the Problem of Current-Voltage Performance of Polycrystalline Photovoltaic Modules Deployed at Fixed Latitude Tilt,” Proc. 31st IEEE PV Spec. Conf., Orlando,FL, Jan. 3-7, 2005, pp. 331-335.
- [5] C.R.Osterwald et al., “Comparison of degradation rates of individual modules held at maximum power”. 4th IEEE World Conference on Photovoltaic Energy Conversion, 2006; pp. 2085–2088.
- [6] PVUSA Test Conditions (PTC): Irradiance = 1000 W/m², Tambient = 20°C, Wind Speed = 1 m/s
- [7] C. Jennings. PV Module Performance at PG&E. Proc. 20th PV Specialist Conference, Las Vegas, 1988, 1225.
- [8] C.M. Whitaker et al., “Application and Validation of a New PV Performance Characterization Method”, Proc. 26th IEEE PV Specialist Conference, Anaheim, 1997, 1253.

[9] ISO Guide to the Expression of Uncertainty in Measurement or GUM, 1995. The U.S. edition of the GUM is entitled: American National Standard for Expressing Uncertainty--U.S. Guide to the Expression of Uncertainty in Measurement, ANSI/NCSL Z540-2-1997

[10] D.R. Myers et al., "Optical Radiation Measurements for Photovoltaic Applications: Instrument Uncertainty and Performance", 2004, NREL Conference Paper NREL/CP-560-36320.

[11] D.R. Myers, et al. 2002, "Recent Progress in Reducing the Uncertainty in and Improving Pyranometer Calibrations." Transactions of the ASME, Vol 124, pp 44-49, February 2002

[12] C.R. Osterwald et al., "Comparison of Degradation Rates of Individual Modules Held at Maximum Power", Proc. of the 4th IEEE World Conference on Photovoltaic Energy Conversion, Hawaii, 2006.

REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

The public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing the burden, to Department of Defense, Executive Services and Communications Directorate (0704-0188). Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number.

PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ORGANIZATION.

1. REPORT DATE (DD-MM-YYYY) February 2011		2. REPORT TYPE Conference Paper		3. DATES COVERED (From - To)		
4. TITLE AND SUBTITLE Outdoor PV Degradation Comparison			5a. CONTRACT NUMBER DE-AC3608GO28308			
			5b. GRANT NUMBER			
			5c. PROGRAM ELEMENT NUMBER			
6. AUTHOR(S) D.C. Jordan, R.M. Smith, C.R. Osterwald, E. Gelak, and S.R. Kurtz			5d. PROJECT NUMBER NREL/CP-5200-47704			
			5e. TASK NUMBER PVA9.1310			
			5f. WORK UNIT NUMBER			
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) National Renewable Energy Laboratory 1617 Cole Blvd. Golden, CO 80401-3393				8. PERFORMING ORGANIZATION REPORT NUMBER NREL/CP-5200-47704		
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)				10. SPONSOR/MONITOR'S ACRONYM(S) NREL		
				11. SPONSORING/MONITORING AGENCY REPORT NUMBER		
12. DISTRIBUTION AVAILABILITY STATEMENT National Technical Information Service U.S. Department of Commerce 5285 Port Royal Road Springfield, VA 22161						
13. SUPPLEMENTARY NOTES						
14. ABSTRACT (Maximum 200 Words) As photovoltaic (PV) penetration of the power grid increases, it becomes vital to know how decreased power output may affect cost over time. In order to predict power delivery, the decline or degradation rates must be determined accurately. At the Performance and Energy Rating Testbed (PERT) at the Outdoor Test Facility (OTF) at the National Renewable Energy Laboratory (NREL) more than 40 modules from more than 10 different manufacturers were compared for their long-term outdoor stability. Because it can accommodate a large variety of modules in a limited footprint the PERT system is ideally suited to compare modules side-by-side under the same conditions.						
15. SUBJECT TERMS PV degradation; PV modules						
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT UL	18. NUMBER OF PAGES	19a. NAME OF RESPONSIBLE PERSON	
a. REPORT Unclassified	b. ABSTRACT Unclassified	c. THIS PAGE Unclassified			19b. TELEPHONE NUMBER (Include area code)	

Standard Form 298 (Rev. 8/98)
Prescribed by ANSI Std. Z39.18